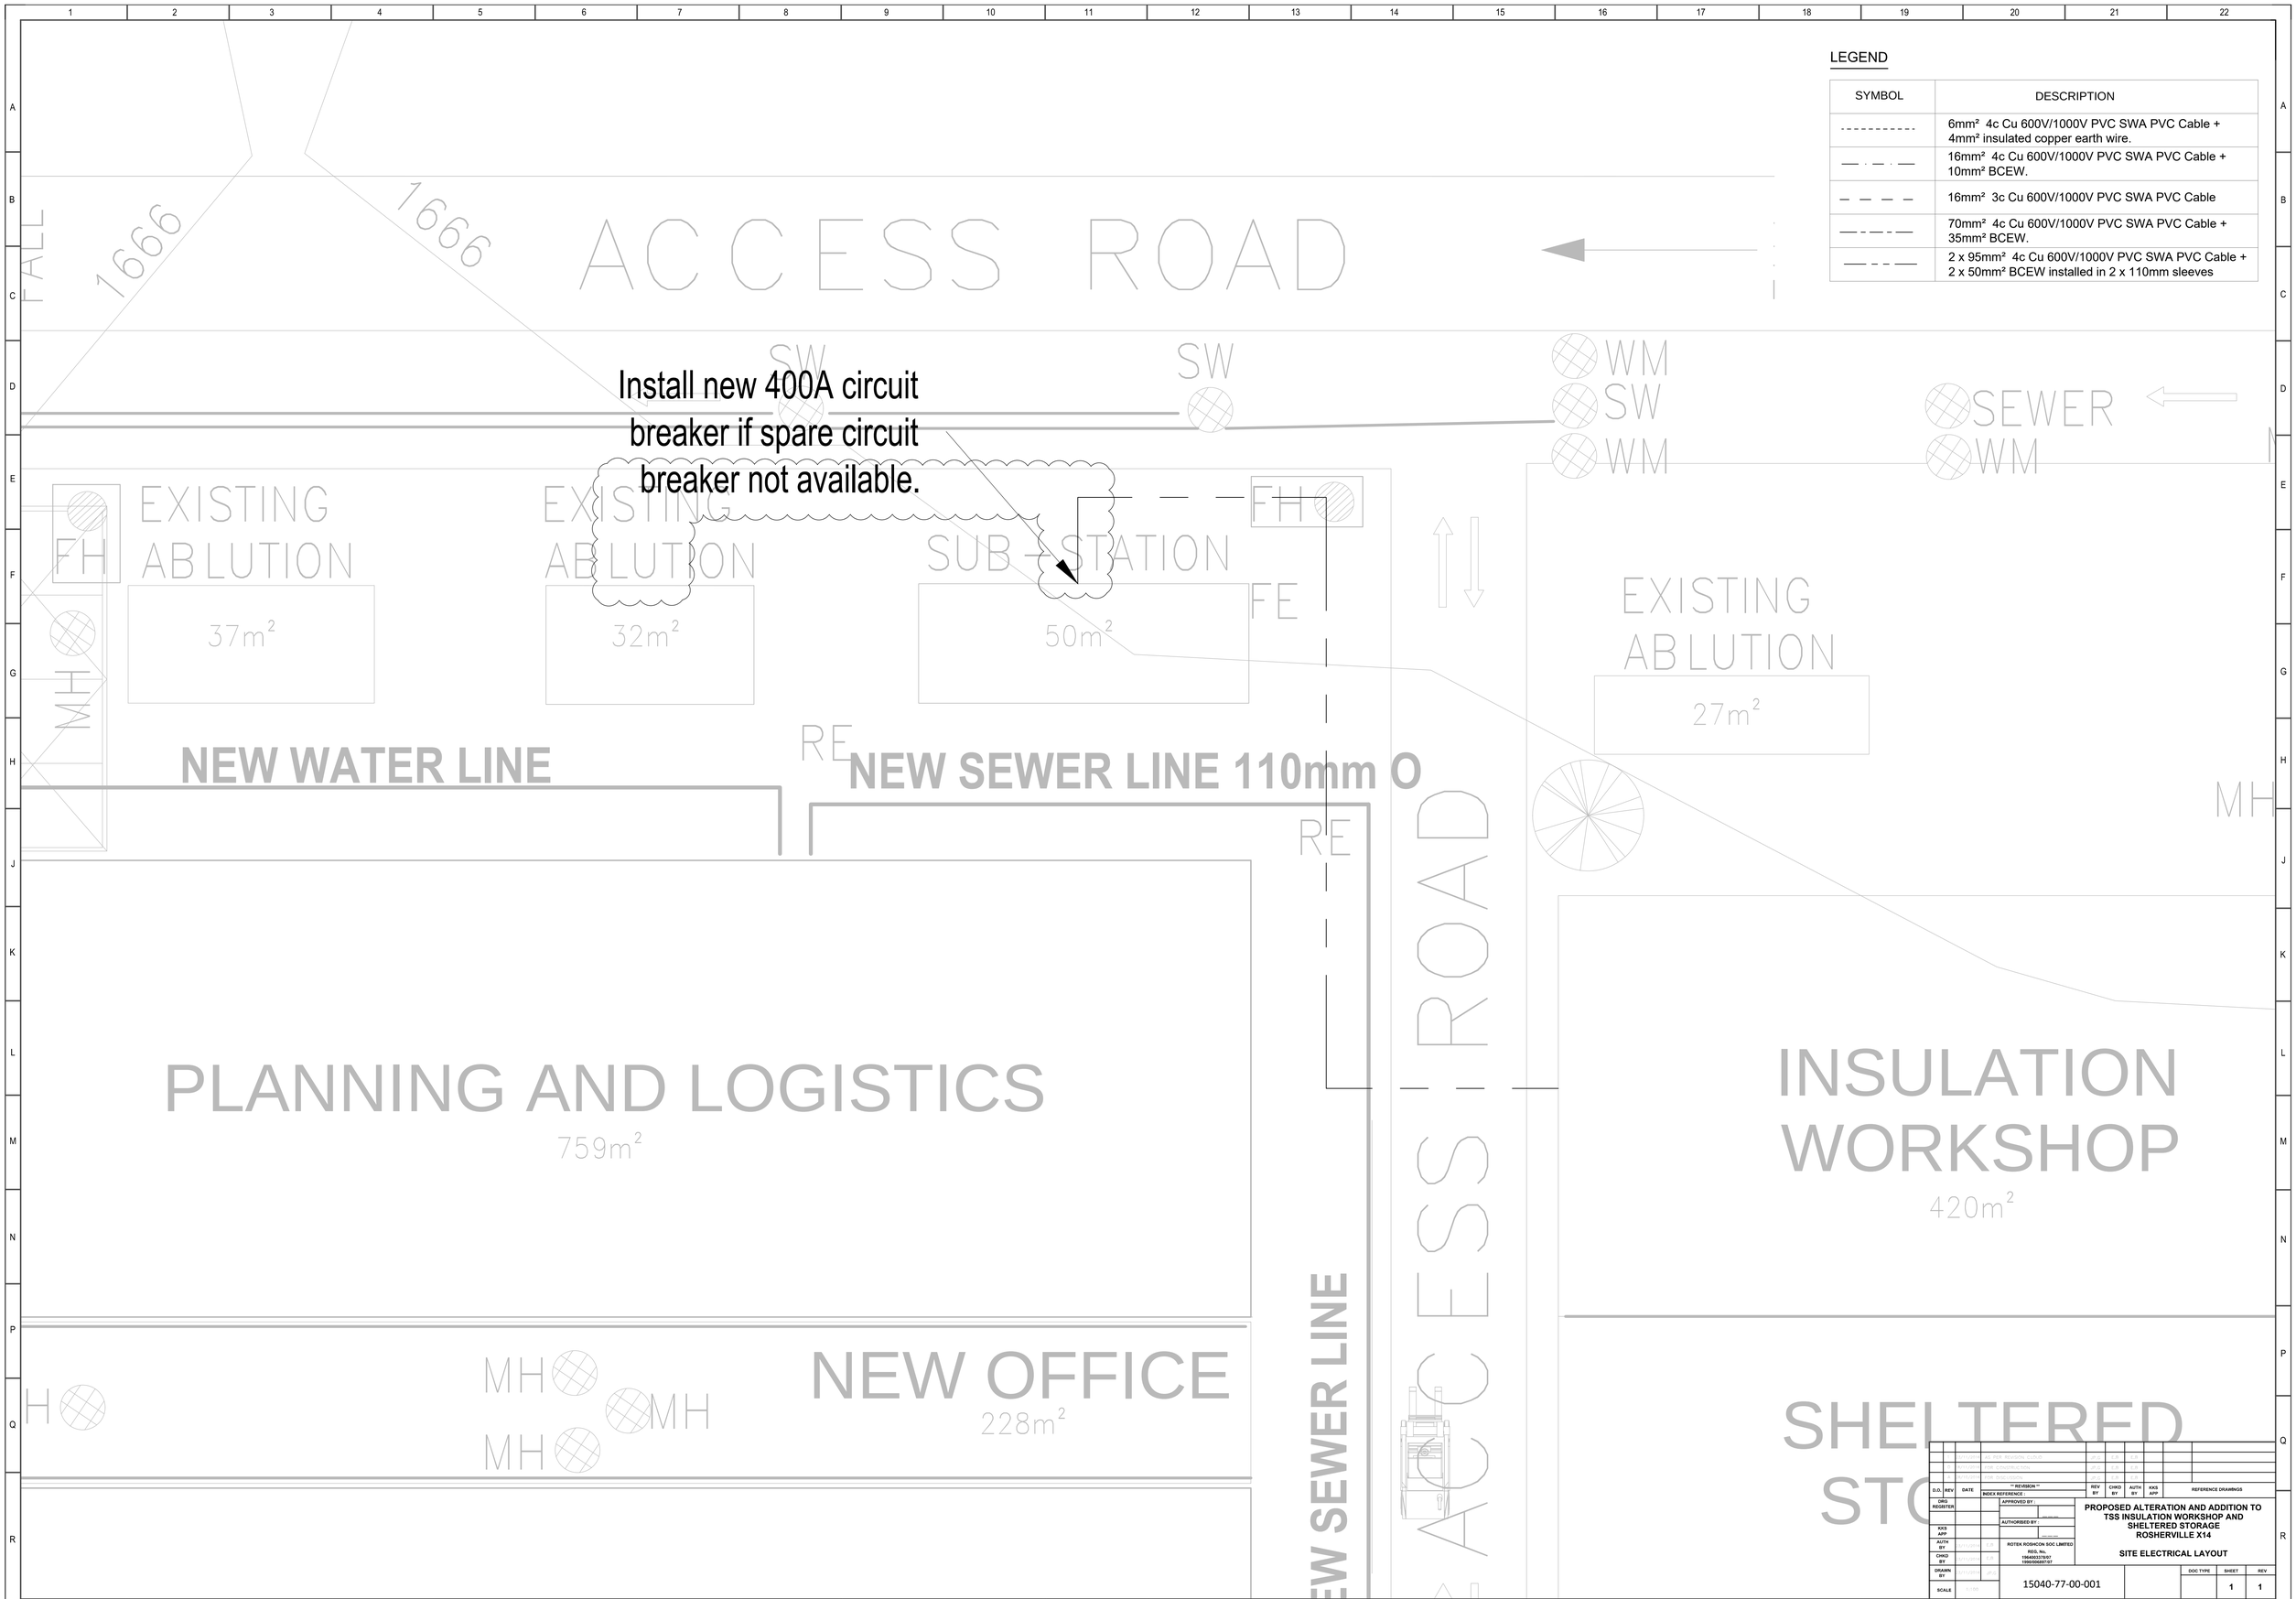

LEGEND

SYMBOL	DESCRIPTION
- - - - - - - - - -	6mm² 4c Cu 600V/1000V PVC SWA PVC Cable + 4mm² insulated copper earth wire.
— · — · —	16mm² 4c Cu 600V/1000V PVC SWA PVC Cable + 10mm² BCEW.
— — — —	16mm² 3c Cu 600V/1000V PVC SWA PVC Cable
— - — - —	70mm² 4c Cu 600V/1000V PVC SWA PVC Cable + 35mm² BCEW.
— - - —	2 x 95mm² 4c Cu 600V/1000V PVC SWA PVC Cable + 2 x 50mm² BCEW installed in 2 x 110mm sleeves

D.O.	REV	DATE	INDEX REFERENCE :	REV BY	CHKD BY	AUTH BY	KKS APP	REFERENCE DRAWINGS

DRG REGISTER

KKS APP

AUTH BY

CHKD BY

DRAWN BY

SCALE 1:100

APPROVED BY :

AUTHORISED BY :

ROTEK ROSHCON SOC LIMITED
REG. No.
1964/003375/07
1990/006897/07

PROPOSED ALTERATION AND ADDITION TO TSS INSULATION WORKSHOP AND SHELTERED STORAGE ROSHERVILLE X14

SITE ELECTRICAL LAYOUT

15040-77-00-001

DOC TYPE	SHEET	REV
	1	1

SIZE GRIDSTYLE A1